



Water Safety in Distribution Systems

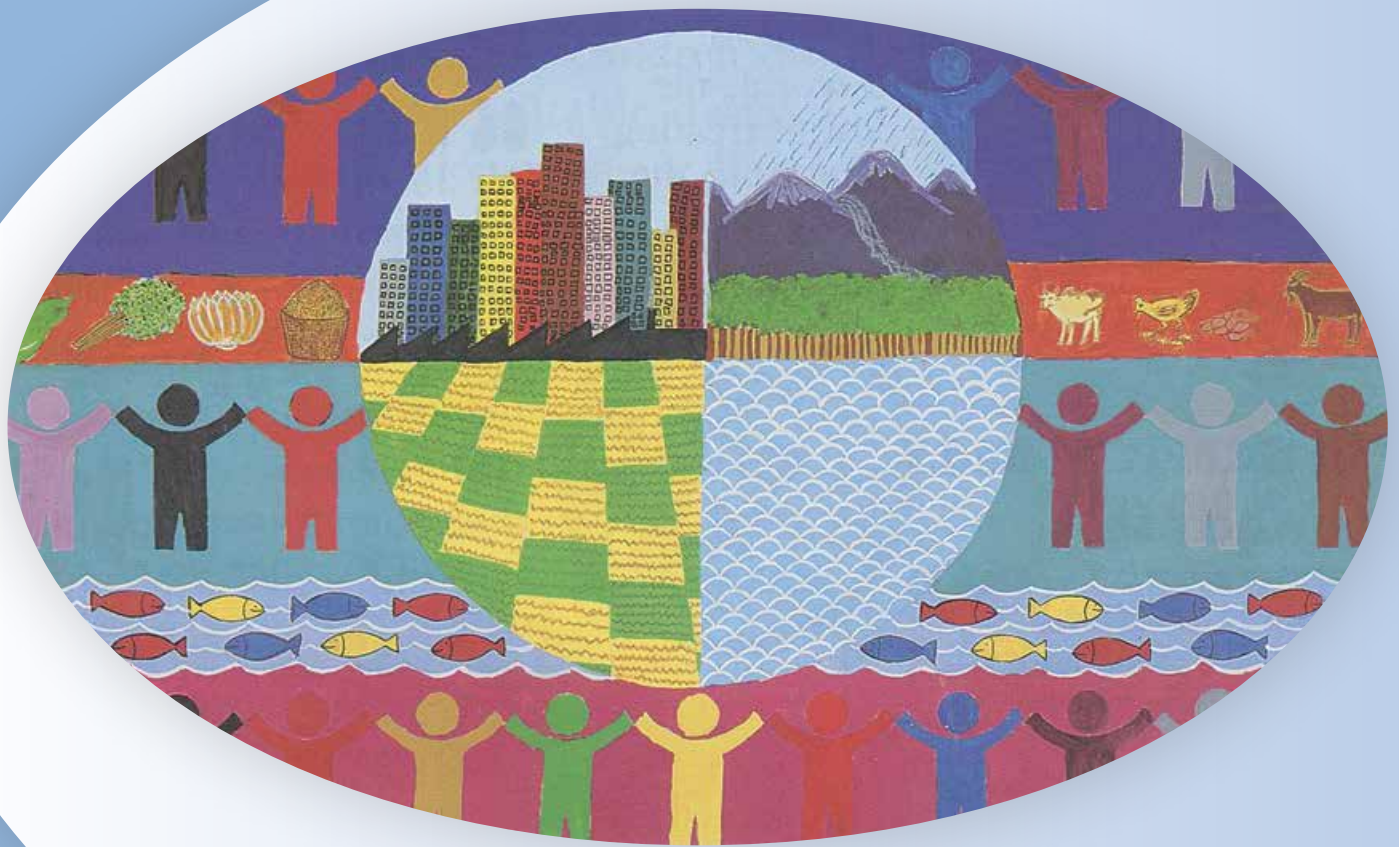

World Health
Organization

Water Safety in Distribution Systems

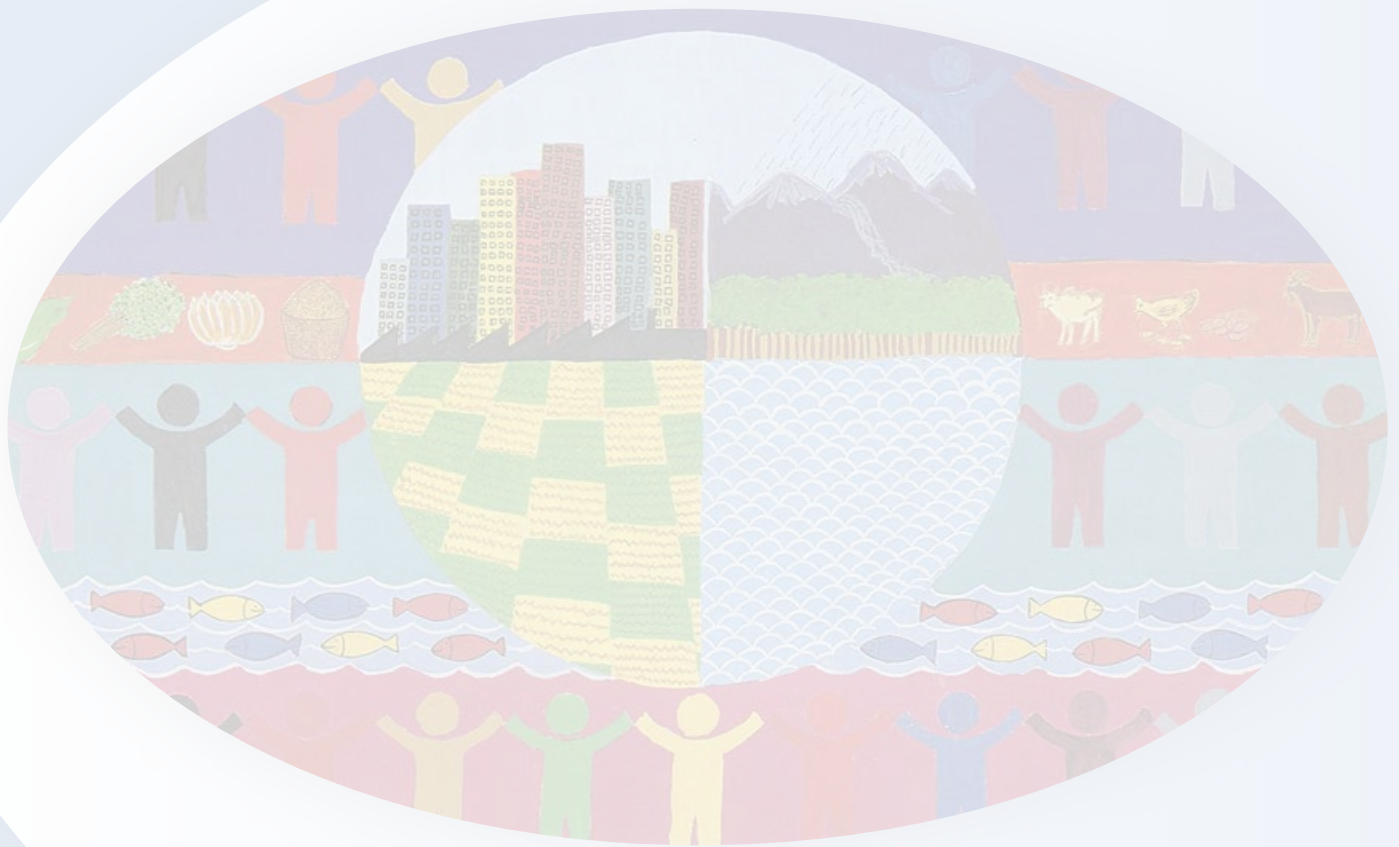

World Health
Organization

WHO Library Cataloguing-in-Publication Data

Water safety in distribution systems.

1. Water Quality. 2. Drinking Water. 3. Water Pollution. 4. Water Supply - standards. I. World Health Organization.

ISBN 978 92 4 154889 2

(NLM classification: WA 675)

© World Health Organization 2014

The illustration of the cover page is extracted from Rescue Mission: Planet Earth, © Peace Child international 1994; used by permission.

All rights reserved. Publications of the World Health Organization are available on the WHO website (www.who.int) or can be purchased from WHO Press, World Health Organization, 20 Avenue Appia, 1211 Geneva 27, Switzerland (tel.: +41 22 791 3264; fax: +41 22 791 4857; e-mail: bookorders@who.int).

Requests for permission to reproduce or translate WHO publications –whether for sale or for non-commercial distribution– should be addressed to WHO Press through the WHO website (www.who.int/about/licensing/copyright_form/en/index.html).

The designations employed and the presentation of the material in this publication do not imply the expression of any opinion whatsoever on the part of the World Health Organization concerning the legal status of any country, territory, city or area or of its authorities, or concerning the delimitation of its frontiers or boundaries. Dotted and dashed lines on maps represent approximate border lines for which there may not yet be full agreement.

The mention of specific companies or of certain manufacturers' products does not imply that they are endorsed or recommended by the World Health Organization in preference to others of a similar nature that are not mentioned. Errors and omissions excepted, the names of proprietary products are distinguished by initial capital letters.

All reasonable precautions have been taken by the World Health Organization to verify the information contained in this publication. However, the published material is being distributed without warranty of any kind, either expressed or implied. The responsibility for the interpretation and use of the material lies with the reader. In no event shall the World Health Organization be liable for damages arising from its use.

Design and layout: paprka-annecy.com

Printed by the WHO Document Production Services, Geneva, Switzerland

Contents

ACKNOWLEDGEMENTS	4
INTRODUCTION	6
WATER SAFETY PLANS	10
1. ASSEMBLE THE WSP TEAM	11
2. DESCRIBE THE WATER SUPPLY SYSTEM	13
2.1 Types of water transmission or distribution system	14
2.2 Components of water transmission or distribution systems	15
2.3 Other important information and relevant performance indicators	16
2.4 Informal settlements	17
3. IDENTIFY HAZARDS AND HAZARDOUS EVENTS AND ASSESS THE RISKS	19
3.1 Hazards	20
3.1.1 Microbial hazards	20
3.1.2 Chemical hazards	22
3.1.2.1 Disinfection by-products	22
3.1.2.2 Chemicals from pipe materials and fittings	22
3.1.2.3 Water treatment chemicals	23
3.1.3 Physical hazards	24
3.2 Hazardous events	24
3.2.1 Physical integrity	26
3.2.1.1 Physical faults, illegal connections, programmed shutdowns and recharge	26
3.2.1.2 Cross-connections and backflow	27
3.2.1.3 Contamination of storage reservoirs	28
3.2.1.4 Plumbing issues and protecting the water supply at the customer interface	29
3.2.1.5 Construction work, renovations and repairs	32
3.2.2 Hydraulic integrity	33
3.2.2.1 Changes in water flow due to intermittent water supply	33
3.2.2.2 Changes in water flow due to mixing of water sources	34
3.2.3 Water quality integrity	35
3.2.3.1 Release of hazards from materials and fittings, including corrosion and scaling	35
3.2.3.2 Treatment process changes with an impact on distribution	39
3.2.3.3 Microbial growth and biofilms	41
3.2.3.4 Water ageing	42
3.3 Risk assessment	44
3.3.1 Semi-quantitative risk assessment	44
3.3.2 Quantitative microbial risk assessment	44
4. DETERMINE AND VALIDATE CONTROL MEASURES, REASSESS AND PRIORITIZE THE RISKS	47
4.1 Determine current control measures	48
4.2 Validation of control measures	52
4.3 Reassess and prioritize the risks	54
5. DEVELOP, IMPLEMENT AND MAINTAIN AN IMPROVEMENT/UPGRADE PLAN	57

6.	DEFINE MONITORING OF THE CONTROL MEASURES	59
6.1	Selection of appropriate operational monitoring parameters.....	60
6.1.1	Types of parameters.....	64
6.1.2	On-line operational monitoring	65
6.1.2.1	Disinfectant residual	65
6.1.2.2	Flow	65
6.1.2.3	pH	65
6.1.2.4	Pressure.....	65
6.1.2.5	Temperature.....	65
6.1.2.6	Turbidity.....	65
6.1.2.7	Chemical parameters.....	66
6.1.2.8	Biological monitoring devices	66
6.2	Reviewing operational monitoring data.....	66
7.	VERIFY THE EFFECTIVENESS OF THE WSP.....	67
7.1	Verification monitoring	68
7.1.1	Microbial parameters	69
7.1.2	Chemical parameters.....	69
7.1.2.1	Health-related chemicals	69
7.1.2.2	Metals that influence acceptability.....	70
7.1.3	Example distribution system verification monitoring programme	70
7.1.4	Choosing sampling locations	70
7.1.4.1	Designating sampling zones	70
7.1.4.2	Selection of sampling sites	71
7.1.5	Sampling frequency.....	71
7.2	Customer satisfaction	72
7.3	Internal and external auditing	72
7.3.1	Internal audits.....	73
7.3.2	External audits.....	73
8.	PREPARE MANAGEMENT PROCEDURES	75
8.1	Standard operating procedures.....	76
8.1.1	Positive pressure and adequate flows	77
8.1.2	Intermittent flows	77
8.1.3	Maintaining disinfectant residuals.....	77
8.1.4	Mixing water sources	78
8.1.5	Inspection and maintenance of storage tanks/service reservoirs, valves and other fittings.....	78
8.1.6	Water leakage management	80
8.1.7	Preventing corrosion	80
8.1.8	Selection of pipe materials and chemicals.....	80
8.1.9	Connection of new customers (including cross-connection control and backflow prevention)....	81
8.1.10	Repair of water main breaks	81
8.1.11	Construction and commissioning of new mains	83
8.1.12	Dewatering and recharging distribution mains	83
8.1.13	Permeation	84
8.1.14	Collection and testing of water samples (what, where, when, how and who).....	84
8.1.15	Calibrating equipment.....	84
8.1.16	Customer complaints	84
8.2	Incident criteria and protocols.....	84
9.	DEVELOP SUPPORTING PROGRAMMES.....	87
10.	PLAN AND CARRY OUT PERIODIC REVIEW OF THE WSP.....	91
11.	REVISE THE WSP FOLLOWING AN INCIDENT.....	93

12. ENABLING ENVIRONMENT	95
12.1 Regulatory and policy frameworks	96
12.1.1 Water quality legislation	96
12.1.2 Economic legislation	97
12.2 Independent surveillance, audits and inspections	98
12.3 Disease and outbreak surveillance	98
12.3.1 Disease surveillance	98
12.3.2 Disease and outbreak investigation	99
12.3.3 Communication, recording and reporting	100
12.3.4 Lessons learnt	100
12.4 Standards, codes of practice and certification	100
12.4.1 Distribution system design codes	100
12.4.2 National standards and certification systems	101
12.5 Capacity building	102
12.5.1 Training	102
12.5.2 Training providers	102
12.5.3 Maintenance contractors	102
12.5.4 Independent auditors	103
12.5.5 Risk assessors	103
REFERENCES	104
CASE-STUDY ANNEXES	115
Case-study 1: Application of a predictive model for water distribution system risk assessment in India	115
Case-study 2: Distribution network management utilizing the block system to reduce non-revenue water in Phnom Penh, Cambodia	120
Case-study 3: Water safety plans and distribution systems – the case of Spanish Town, Jamaica	123
Case-study 4: Drinking-water contamination incident in Johannesburg, South Africa	127
Case-study 5: Incident management in the water distribution system in Johannesburg, South Africa	131
Case-study 6: Black water complaints from western parts of Singapore in the 1980s	134
Case-study 7: Implementation of massive replacement programmes for unlined galvanized iron connections and unlined cast iron mains in Singapore in response to poor water quality after commissioning of the Kranji/Pandan scheme (1983–1993)	137
Case-study 8: Contamination of water supply incident in Bukit Timah Plaza/Sherwood Tower Condominium in Singapore in 2000	139
Case-study 9: Introduction of the “TOKYO High Quality Program” (Tokyo’s version of the water safety plan)	142
Case-study 10: Incidents from “Lessons learnt from plumbing incidents – responses and preventions”, Japan Water Plumbing Engineering Promotion Foundation (2011)	146

Acknowledgements

The World Health Organization (WHO) wishes to express its appreciation to all whose efforts made this production possible. In particular, WHO gratefully acknowledges the contributions of the following international experts, who contributed to and reviewed the publication:

Lead editor and advisor

David CUNLIFFE, South Australia Department of Health, Australia

Advisory team members

Jayant BHAGWAN, Water Research Commission, South Africa

Lesley D'ANGLADA, United States Environmental Protection Agency, United States of America

Asoka JAYARATNE, Yarra Valley Water, Australia

Nonhlanhla KALEBAILA, Water Research Commission, South Africa

Pawan LABHASETWAR, National Environmental Engineering Research Institute, India

Edward OHANIAN, United States Environmental Protection Agency, United States of America

Dai SIMAZAKI, National Institute of Public Health, Japan

Dave VIOLA, International Association of Plumbing and Mechanical Officials and World Plumbing Council, United States of America

Kee Wei WONG, PUB, the national water agency, Singapore

Authors

Nicholas ASHBOLT, School of Public Health, University of Alberta, Canada

David CUNLIFFE, South Australia Department of Health, Australia

Lesley D'ANGLADA, United States Environmental Protection Agency, United States of America

Peter GREINER, NSF International, United States of America

Rajesh GUPTA, Visvesvaraya National Institute of Technology, India

John HEARN, ALS Water Resources Group, Australia

Asoka JAYARATNE, Yarra Valley Water, Australia

Kah Cheong LAI, PUB, the national water agency, Singapore

Nicholas O'CONNOR, Ecos Environmental Consulting, Australia

Dave PURKISS, NSF International, United States of America

预览已结束，完整报告链接和二维码如下：

https://www.yunbaogao.cn/report/index/report?reportId=5_27829

